






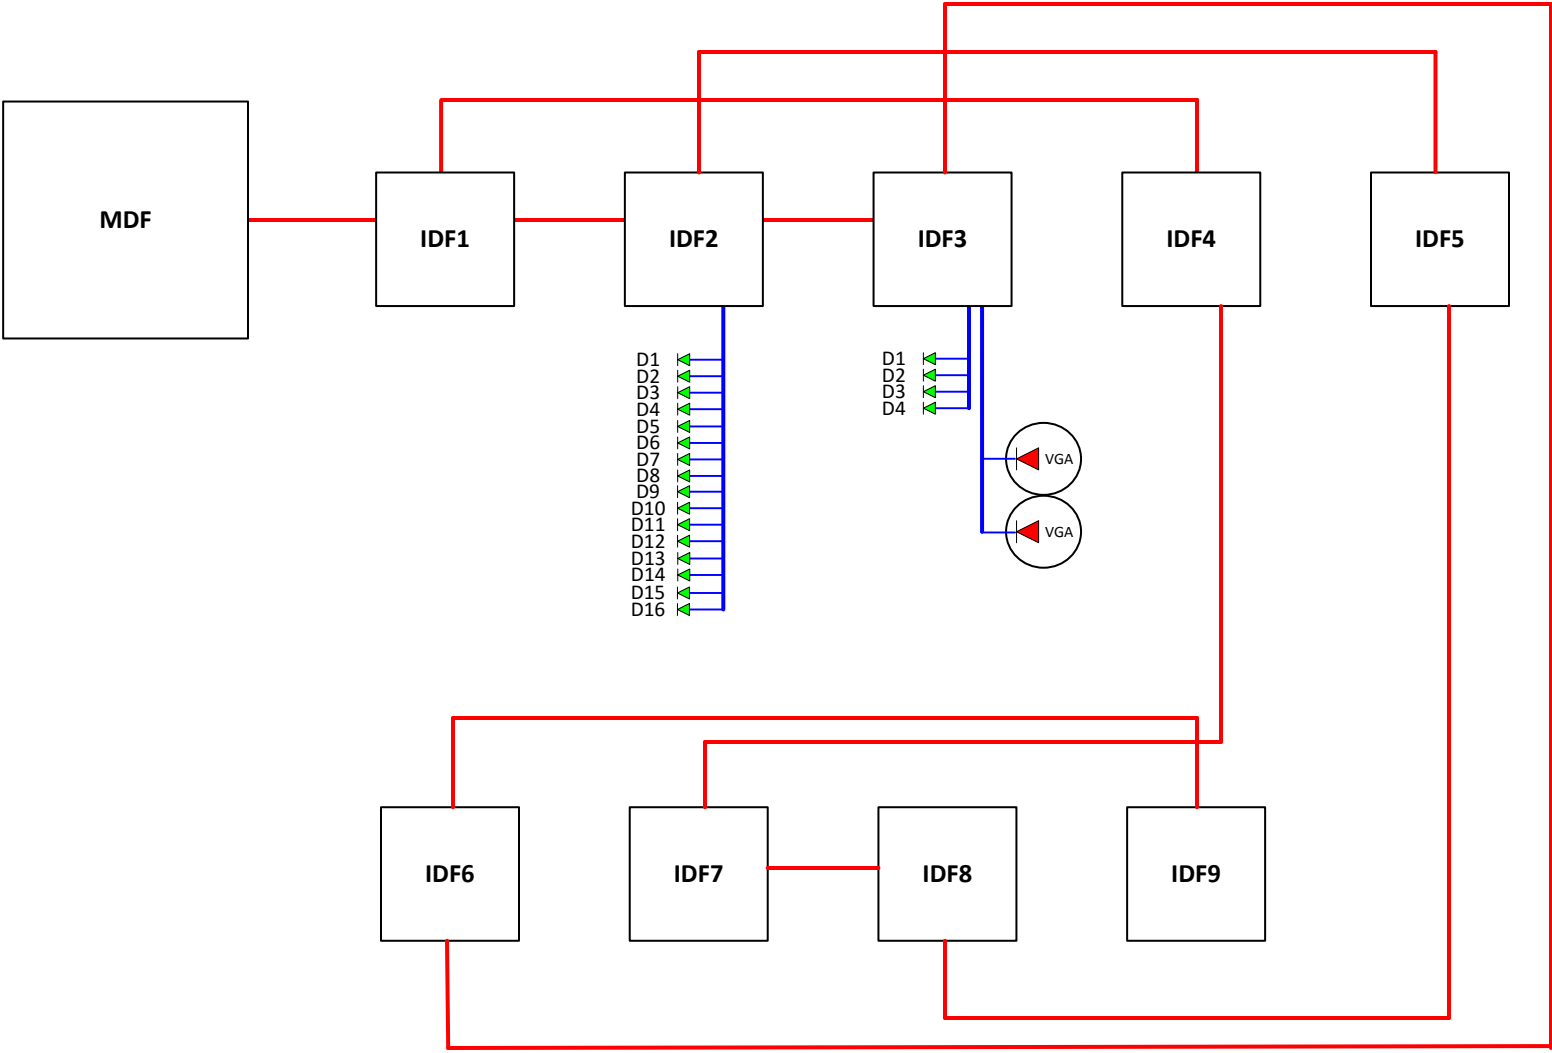
Date	4/19/2016
Diagram created for: Keith Estes 678-374-5934	
Client	Pratt Industries
Site	Ft. Worth TX

Pratt – Ft. Worth TX

Block Diagram

IN STRICT CONFIDENCE. All rights reserved. Disclosure to third parties of this document or any part thereof, or the use of any information contained therein for purposes other than provided for by this document is not permitted, except with the express written permission of Scott M. Conkel and/or Georgia Low Voltage Technologies Inc.

-  Access Point
-  Wall/Pole Mount Cabinet
-  Existing Data Drop
-  New Data Drop
-  PC VGA extended over Cat.6








Date	6/19/2016
Diagram created for: Keith Estes 678-374-5934	
Client	Pratt Industries
Site	Ft. Worth TX

# Pratt – Ft. Worth TX

## Site Diagram

IN STRICT CONFIDENCE. All rights reserved. Disclosure to third parties of this document or any part thereof, or the use of any information contained therein for purposes other than provided for by this document is not permitted, except with the express written permission of Scott M. Conkel and/or Georgia Low Voltage Technologies Inc.

-  Access Point
-  Wall/Pole Mount Cabinet
-  Existing Data Drop
-  New Data Drop

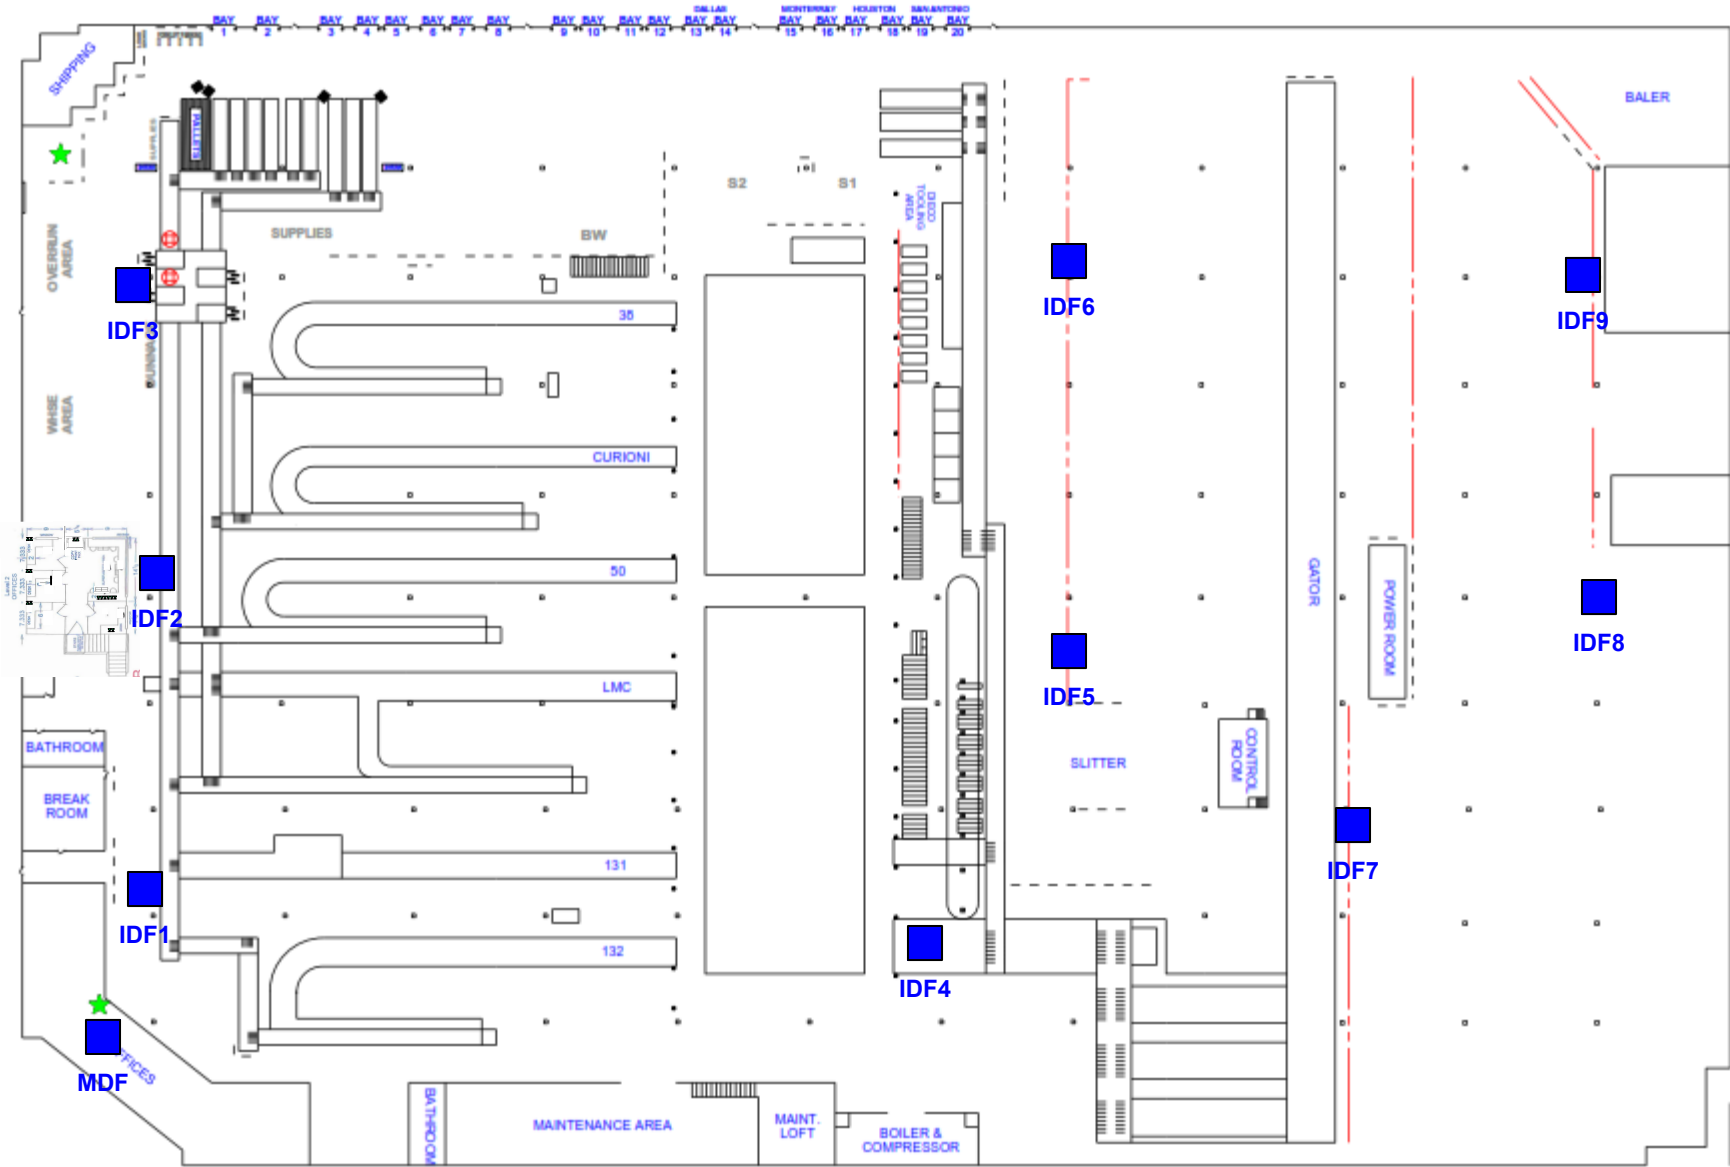

Date	4/19/2016
Diagram created for: Keith Estes 678-374-5934	
Client	Pratt Industries
Site	Ft. Worth TX


Pratt – Ft. Worth TX

Admin. 2<sup>nd</sup> Floor

IN STRICT CONFIDENCE. All rights reserved. Disclosure to third parties of this document or any part thereof, or the use of any information contained therein for purposes other than provided for by this document is not permitted, except with the express written permission of Scott M. Conkel and/or Georgia Low Voltage Technologies Inc.

- Access Point
- Wall/Pole Mount Cabinet
- Existing Data Drop
- New Data Drop

All new Cat.6 Data cables will be home run to IDF2

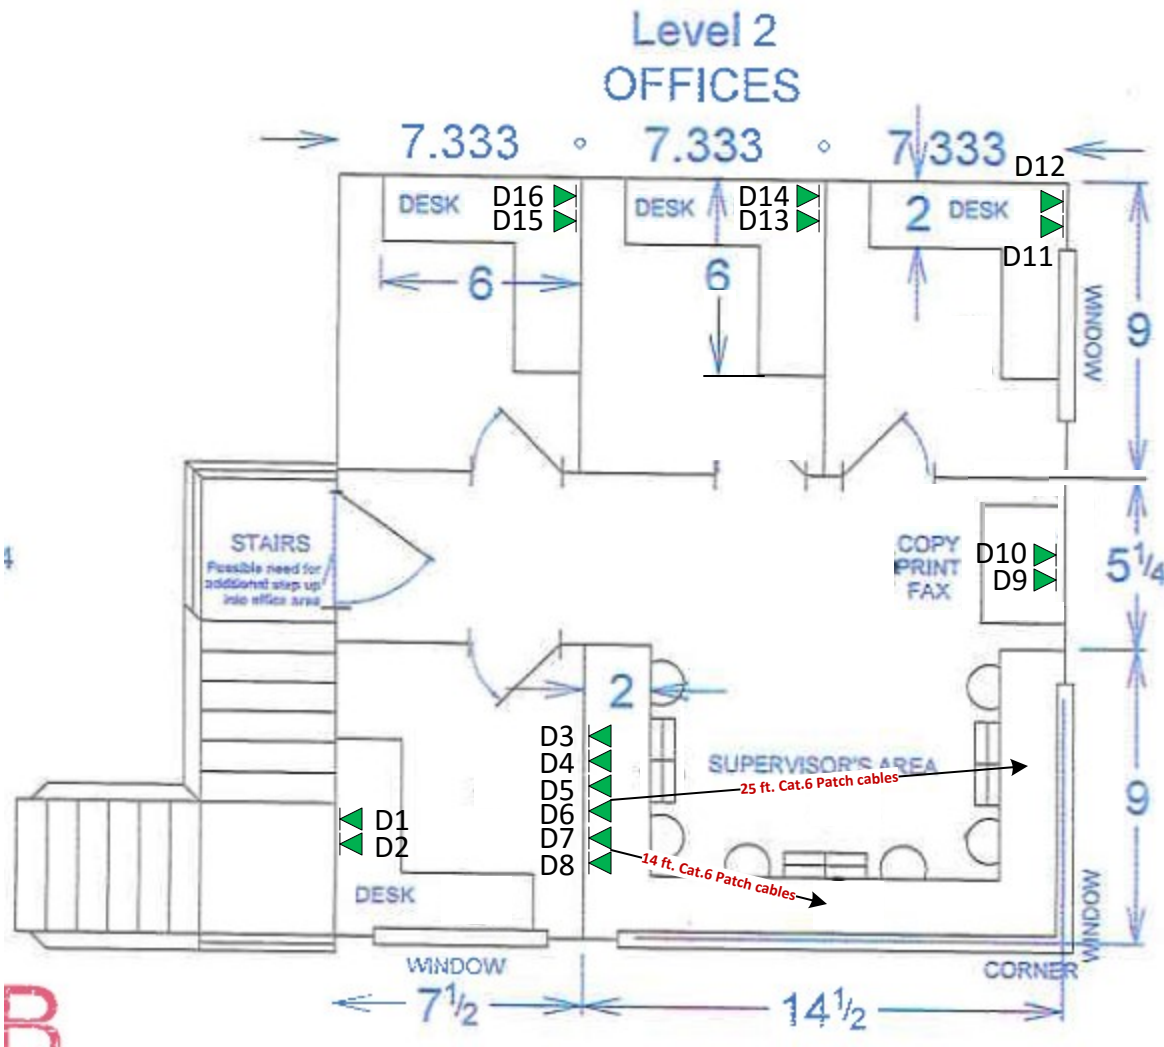






Date	4/19/2016
Diagram created for: Keith Estes 678-374-5934	
Client	Pratt Industries
Site	Ft. Worth TX


Pratt – Ft. Worth TX

Shipping

IN STRICT CONFIDENCE. All rights reserved. Disclosure to third parties of this document or any part thereof, or the use of any information contained therein for purposes other than provided for by this document is not permitted, except with the express written permission of Scott M. Conkel and/or Georgia Low Voltage Technologies Inc.

-  Access Point
-  Wall/Pole Mount Cabinet
-  Existing Data Drop
-  New Data Drop
-  PC VGA extended over Cat.6

All new Cat.6 Data cables will be home run to IDF3

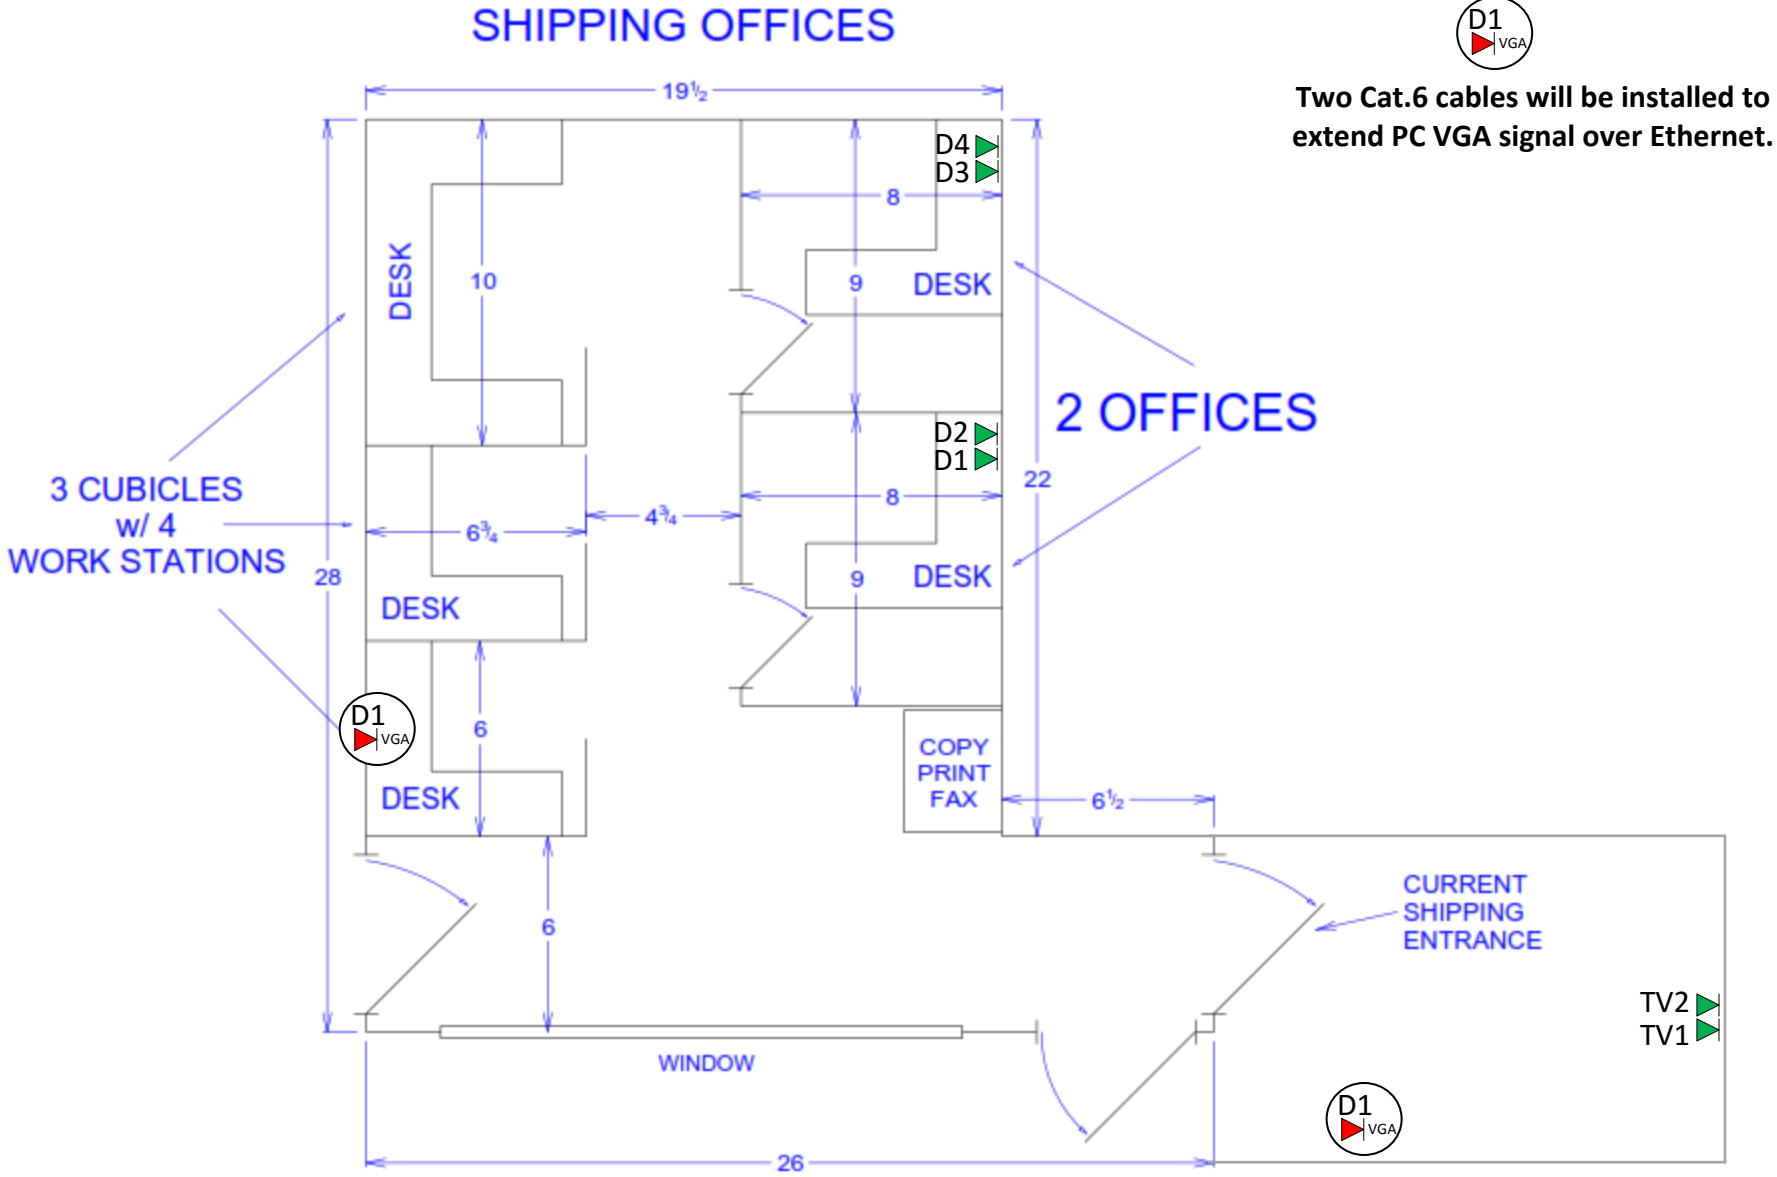





Date	4/19/2016
Diagram created for: Keith Estes 678-374-5934	
Client	Pratt Industries
Site	Ft. Worth TX


Pratt – Ft. Worth TX

IDF1

IN STRICT CONFIDENCE. All rights reserved. Disclosure to third parties of this document or any part thereof, or the use of any information contained therein for purposes other than provided for by this document is not permitted, except with the express written permission of Scott M. Conkel and/or Georgia Low Voltage Technologies Inc.

-  Access Point
-  Wall/Pole Mount Cabinet
-  Existing Data Drop
-  New Data Drop

Rack Mount Fiber Cabinet  
24-Port Gigabit Network Switch  
1u Wire Manager  
16-Port POE Injector  
1u Wire Manager  
Cat.6 Loaded 24-Port Patch Panel

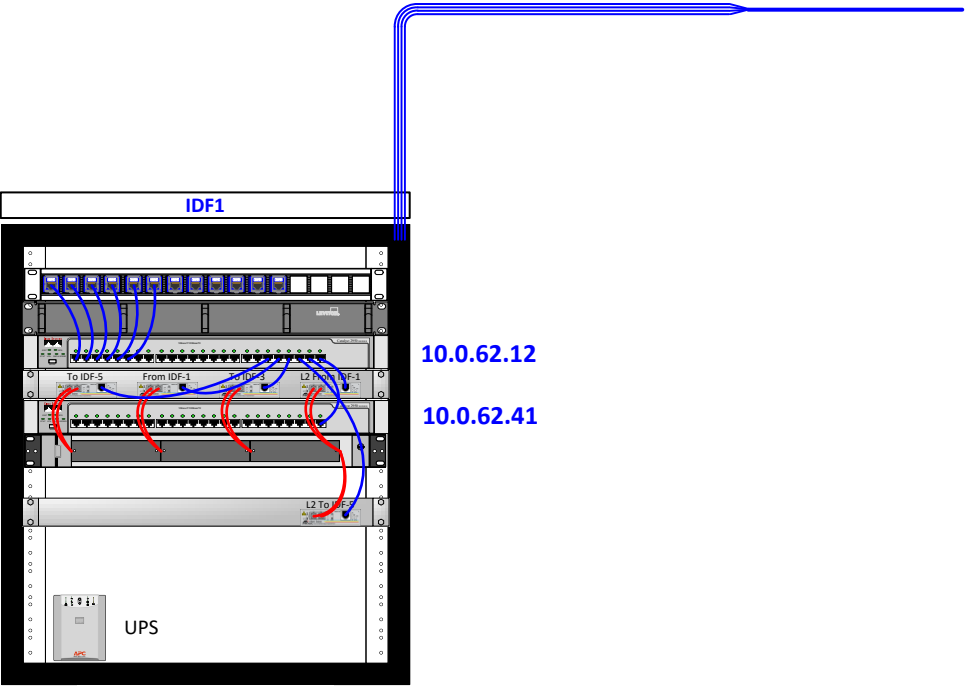






Date	4/19/2016
Diagram created for: Keith Estes 678-374-5934	
Client	Pratt Industries
Site	Ft. Worth TX

# Pratt – Ft. Worth TX

## IDF2


IN STRICT CONFIDENCE. All rights reserved. Disclosure to third parties of this document or any part thereof, or the use of any information contained therein for purposes other than provided for by this document is not permitted, except with the express written permission of Scott M. Conkel and/or Georgia Low Voltage Technologies Inc.

-  Access Point
-  Wall/Pole Mount Cabinet
-  Existing Data Drop
-  New Data Drop

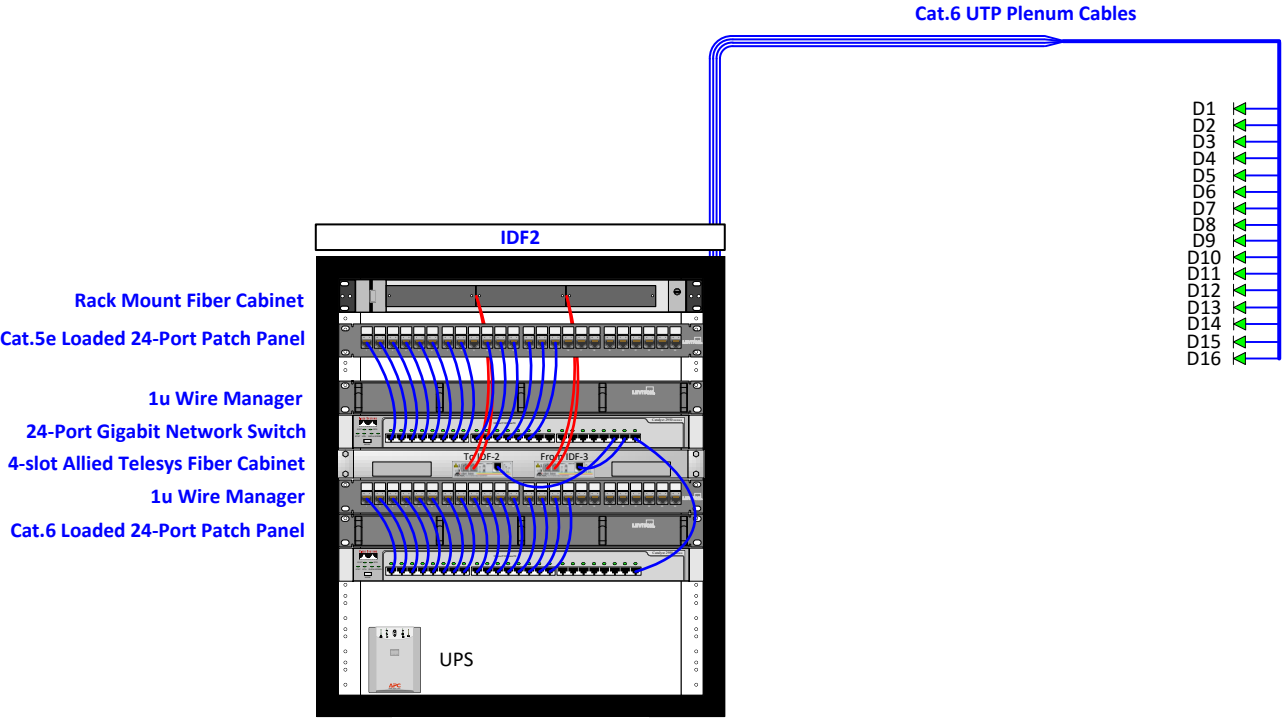

### Additions to IDF2 for project on 5/2016





- 01 ea. Velcro
- 01 ea. 1U Wire Manager
- 01 ea. 24-port Gigabit Network Switch
- 01 ea. 24-port Cat.6 UTP Patch Panel
- 16 ea. Cat.6 Modular Insert, **BLUE**
- 08 ea. 2-port Wall Plate, Ivory
- 08 ea. MP1P Wall Caddy, Single Gang
- 17 ea. 3 ft. Cat.6 UTP Patch Cables, **BLUE**
- 08 ea. 15 ft. Cat.6 UTP Patch Cables, **BLUE**
- 20 ea. Hammer on J-Hooks 1/8 – ¼ flange
- 1760 ft. Cat.6 UTP Plenum Cable, **BLUE**


Date	4/19/2016	
Diagram created for: Keith Estes 678-374-5934		
Client	Pratt Industries	
Site	Ft. Worth TX	

Pratt – Ft. Worth TX

IDF3

IN STRICT CONFIDENCE. All rights reserved. Disclosure to third parties of this document or any part thereof, or the use of any information contained therein for purposes other than provided for by this document is not permitted, except with the express written permission of Scott M. Conkel and/or Georgia Low Voltage Technologies Inc.

-  Access Point
-  Wall/Pole Mount Cabinet
-  Existing Data Drop
-  New Data Drop

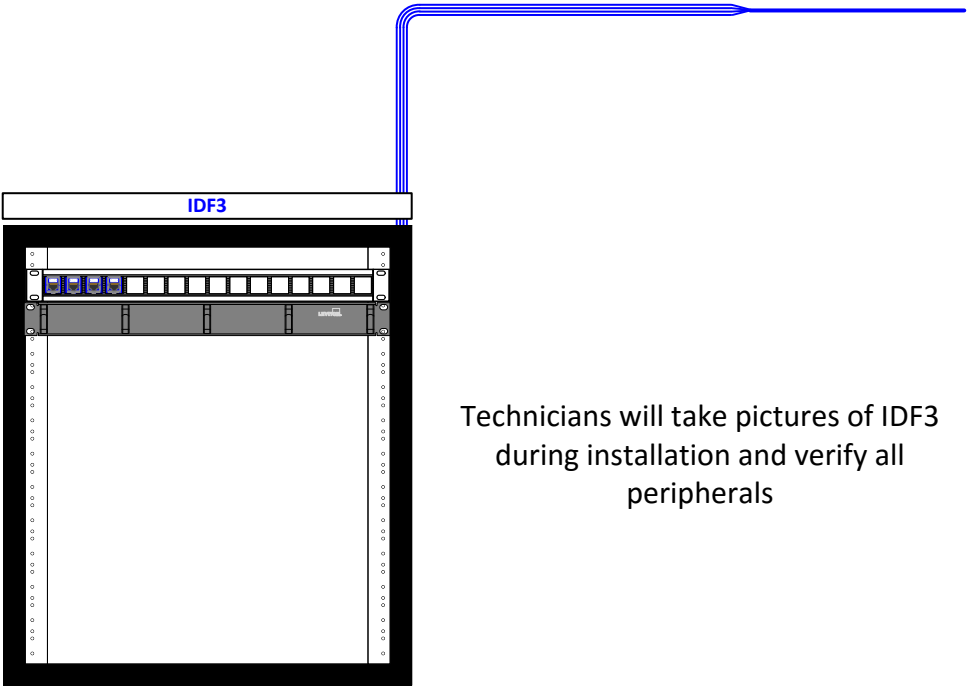

Technicians will take pictures of IDF3 during installation and verify all peripherals

Additions to IDF3 for project on 5/2016






- 01 ea. 16-Port Unloaded Patch Panel
- 01 ea. 1U Wire Manager
- 08 ea. Cat.6 Modular Inserts, **BLUE**
- 04 ea. MP1P Wall Caddy
- 02 ea. 2-Port Wall Plate, Ivory
- 20 ea. Hammer on J-Hooks 1/8 – ¼ flange
- 660 ft. Cat.6 UTP Plenum Cable, **BLUE**


Date	4/19/2016
Diagram created for: Keith Estes 678-374-5934	
Client	Pratt Industries
Site	Ft. Worth TX

# Pratt – Ft. Worth TX

## Video Extender

IN STRICT CONFIDENCE. All rights reserved. Disclosure to third parties of this document or any part thereof, or the use of any information contained therein for purposes other than provided for by this document is not permitted, except with the express written permission of Scott M. Conkel and/or Georgia Low Voltage Technologies Inc.

-  Access Point
-  Wall/Pole Mount Cabinet
-  Existing Data Drop
-  New Data Drop
-  PC VGA extended over Cat.6

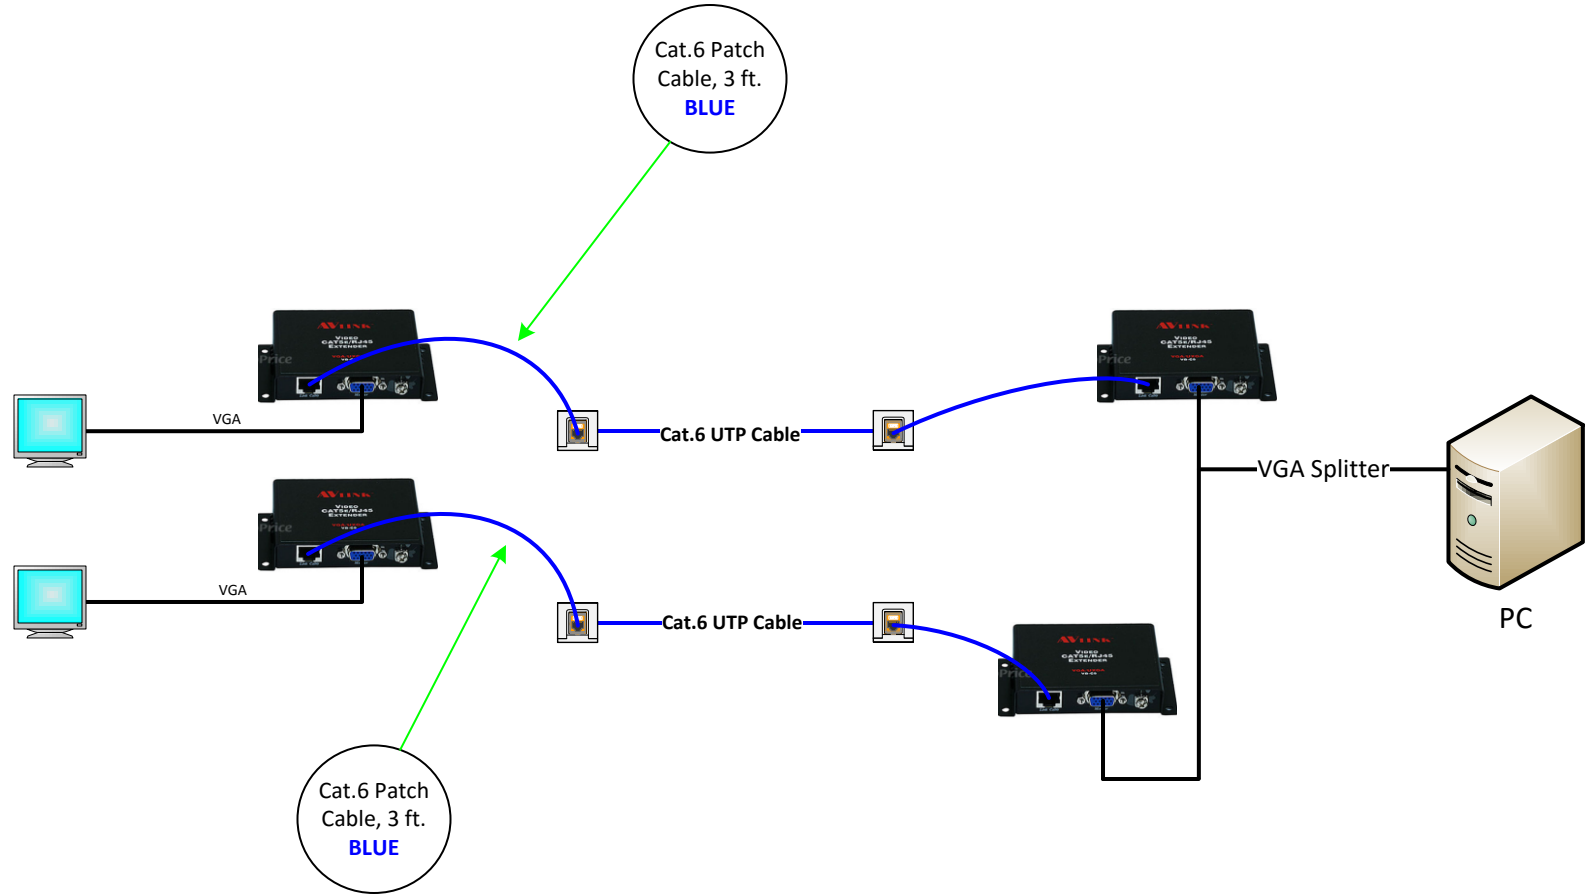

- 02 ea. VGA/RJ45 Video Extender Kit
- 01 ea. VGA Splitter Cable F/M/M
- 02 ea. VGA Cable M/M
- 04 ea. 3 ft. Cat.6 Patch Cable, **BLUE**
- 04 ea. 1-Port Surface Enclosure, Ivory
- 04 ea. Cat.6 Modular Insert, **BLUE**
- 220 ft. Cat.6 UTP Plenum Cable, **BLUE**